

Pollution monitoring data for the GOOGONG sewage treatment plant in accordance with the requirements of the POELA Act 2011 and the POEO Act 195

Site Name:	Googong Water Recycling Plant (STP)	Site Address:	36A Googong Road
Licencee Name	Queanbeyan-Palerang Regional Council	Address	10 Majara Street, BUNGENDORE NSW 2621
EPA Licence #	20188	Link to licence	<u>Licence</u>

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 6 - Discharge point at Beltana Pond 800 - 4 weekly intervals)

	Pollutant	Ammonia	Biochemical Oxygen Demand	Faecal Coliforms	Nitrogen	Oil & Grease	pН	Phosphorus	Total Suspended Solids	Free Chlorine	Diss Al	Tot Al
Licence Limi	t Unit	mg/L	mg/L	cfu/100mL	mg/L	mg/L	pH	mg/L	mg/L	mg/L	mg/L	mg/L
Conditions (se	ect 90% limit	2	5	100	8	2	N/A	0.5	10	N/A	N/A	N/A
L3.4)	100% limit	5	10	200	10	10	Between 6.5 8.5	1	15	0.1	N/A	N/A

Compari	on Year	2020/21											
	Cumant	Min to date	0.00	0.00	0.00	4.34	0.00	7.42	0.09	3.00	0.16	0.02	0.06
	Current	Max to date	0.00	0.00	0.00	4.34	0.00	7.42	0.09	3.00	0.16	0.02	0.06
	Summary Data	Average	0.00	0.00	0.00	4.34	0.00	7.42	0.09	3.00	0.16	0.02	0.06

		Date			Comp	liance	Cor	npliance		Comp	oliance		Comp	liance		Comp	iance		Comp	liance		Comp	liance		Comp	iance		Comp	liance		
Licence Year	Sampled	Obtained	Published	Result	90%limit	100% limit	Result 90%lim	t 100% lim	t Result	90%limit	100% limit																				
2024/25	16/07/2024	25/07/2024	12/08/2024	0.000	PASS	PASS	0.00 PASS	PASS	0.00	PASS	PASS	4.34	PASS	PASS	0.00	PASS	PASS	7.42	N/A	PASS	0.09	PASS	PASS	3.00	PASS	PASS	0.16	N/A	FAIL	0.02	0.06
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
2024/25					PASS	PASS	PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	PASS		PASS	PASS		PASS	PASS		N/A	PASS		
	90th percentile	assessment		0			0		0			4.34			0	•					0.09		-	2					-		

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 8 - Ambient Quality 65m D/S from POINT 3 - 4 weekly intervals)

			Biochemical					Total			Diss	Total
			Oxygen	Faecal			Phosphor	Suspende		Free	Aluminiu	aluminiu
		Ammonia	Demand	Coliforms	Nitrogen	Oil & Grease	us	d Solids	pН	Chlorine	m	m
Current	Min to date	0.10	0.00	27.00	0.96	0.00	0.02	0.00	8.20	0.00	0.02	0.05
Summary Data	Max to date	0.10	0.00	27.00	0.96	0.00	0.02	0.00	8.20	0.00	0.02	0.05
Summary Data	Average	0.10	0.00	27.00	0.96	0.00	0.02	0.00	8.20	0.00	0.02	0.05

		Date		Result	Result	Result	Result	Danulk	Result	Result	Result			
Licence Year	Sampled	Obtained	Published	Result										
2024/25	16/07/2024	25/07/2024	12/08/2024	0.100	0.00	27.00	0.96	0.00	0.02	0.00	8.2	0.00	0.02	0.05
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														

OUTFLOW (HILL 800)

Condition M7.1 - Requirement to monitor volume (EPA Identification point 2 - Hill 800)

Licence Limit
Condition

Inflow daily limit (kL) 12,000

OUTFLOW (BELTANA)

Condition M7.1 - Requirement to monitor volume (EPA Identification point 6 - Beltana Pon

Limit Outflow		
Condition	aily limit (kL) 12,00	0

(sect L4.1)

4

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
21

Total
Minimum
Maximum
Average

				2024/2	025 Licence Yo	ear					
July	August	September	October	November		January	February	March	April	May	June
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0		0
0	0	0	0	0	0	0		0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0		0	0	0	0
0	0	0	0	0	0	0		0	0	0	0
0	0		0		0	0		0		0	
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
					0						
					0						
					0						

Recycled water sent to Hill 800

1	1
2	1
3	1
4	1
5	1
6	1
7	1
8	
9	
10	
11	
12	
13]
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	1
24	
25	
26	
27	1
28	
29	ı
30	ı
31	

	23													
	24													
	25													
	26													
	27													
	28													
	29													
	30													
	31													
	Minimum) 1	0	0	0	0	0	0	0	0	0	0	0	0
+hlv	Minimum Maximum		0 432	0	0	0	0	0	0	0	0	0	0	0
thly														
hly	Maximum		432	0	0	0	0	0	0	0	0	0	0	0
hly	Maximum Average		432 311	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV
	Maximum Average Total		432 311	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0! 0	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	#DIV
hly	Maximum Average Total Minimum		432 311	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0! 0	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	0 #DIV/0!	#DIV

(sect L4.1

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30 31	

	2024/2025 Licence Year										
July	August	September	October	November	December	January	February	March	April	May	June
1259											
857											
906											
822											
1115											
971											
895											
991											
801											
1188											
917											
780											
	1			1	1	1		1			
780	0	0	0	0	0	0	0	0	0	0	0
1,259	0	0	0	0	0	0	0	0	0	0	0
959	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!

	i viii iii ii	
Monthly	Maximum	
ivioriting	Average	
	Total	
	Minimum	
YTD	Maximum	
לוו	Average	
	Total	

780	0	0	0	0	0	0	0	0	0	0	0
1,259	0	0	0	0	0	0	0	0	0	0	0
959	#DIV/0!										
11,502	0	0	0	0	0	0	0	0	0	0	0
780											
					1,259						
959											
11,502											

Inlet Effluent

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	

July	August	September	October	November	December	January	February	March	April	May	June
1299											
1115											
1132											
1138											
1139											
1158											
1220											
1265											
1163											
1124											
1119											
1104											

	Minimum
Monthly	Maximum
iviolitilly	Average
	Total
	Minimum
YTD	Maximum
לוו	Average
	Total

1,104	0	0	0	0	0	0	0	0	0	0	0
1,299	0	0	0	0	0	0	0	0	0	0	0
1,165	#DIV/0!										
13,976	0	0	0	0	0	0	0	0	0	0	0
					1,104						
					1,299						
					1,165	,	,	,	,		,
13,976									,		

Topup Water from ICON

1
2
3
4
5
6
7
8
9
10
 11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31

	Minimum	
Monthly	Maximum	
ivioriting	Average	
	Total	
	Minimum	
YTD	Maximum	
טוץ	Average	
	Total	

					2025 Licence Y						
July	August	September	October	November	December	January	February	March	April	May	June
C											
C											
C											
C											
C											
0											
0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0
0	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0
0	0	0	0	0	0	0	0	0	0	0	0
					0						
					0						
					0						
					0						

Rainfall

		July	August	September	October	November	Dec
	1	3					
	1	0					
	1	0					
	1	0					
	1	0					
,	1	0					
	l	0					
	1	0					
)	1	10.5					
0	1	1					
	l	0					
1 2 3 4 5 6 7 8	l	0					
3	1						
4	1						
5	l						
6	l						
7	l						
В	1						
9	1						
	l						
0 1 2	l						
2	1						
3	1						
3 4 5 6 7	l						
5	l						
6	1						
7	İ						
	ĺ						
9	1						
0	ĺ						
1	1						

	iviinimum	
Monthly	Maximum	
iviolitiliy	Average	
Monthly	Total	
	Minimum	
VTD	Maximum	
YIU	Average	
	Total	

0	0	0	0	0	0	0	0	0	0	0	0
11	0	0	0	0	0	0	0	0	0	0	0
1	#DIV/0!										
15	0	0	0	0	0	0	0	0	0	0	0
					0						
					11						
					1						
					15						



Pollution monitoring data for the BUNGENDORE sewage treatment plant in accordance with the requirements of the POELA Act 2011 and the POEO Act 1997

Site Name:	Bungendore Sewage Treatment Plant	Site Address:	100 Bungendore Road, BUNGENDORE NSW 2621
Licencee Name	Queanbeyan-Palerang Regional Council	Address	10 Majara Street, BUNGENDORE NSW 2621
EPA Licence #	201	Link to licence	<u>Licence</u>

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 3 - Discharge point to Millpost Creek - 4 weekly intervals)

Licence	Pollutant	Ammonia	Biochemical Oxygen Demand	Faecal Coliforms	Nitrogen	Oil & Grease		pН		Phosphorus	Total Suspended Solids	Diss Al	Tot Al
Limit	Unit	mg/I	mg/L	cfu/100mL	mg/L	mg/L		pН		mg/L	mg/L	mg/L	mg/L
Condition	s 90% limit	2	5	100	8	2	N/A			0.5	10	N/A	N/A
(sect L3.		10	10	200	10	10	Between	6.5	8.5	1	15	N/A	N/A

Comparis	on Year	2024/25										
	Current	Min to date	0.30	0.00	0.00	2.95	0.00	7.78	0.00	0.00	0.11	0.25
	Summary	Max to date	0.30	0.00	0.00	2.95	0.00	7.78	0.00	0.00	0.11	0.25
	Data	Average	0.30	0.00	0.00	2.95	0.00	7.78	0.00	0.00	0.11	0.25

Licence	Date			Comp	liance		Comp	oliance		Comp	liance		Comp	liance		Comp	liance											
Year	Sampled Obtain	ed Published	Result	90%limit	100% limit	Result	90%limit	100% limit																				
2024/25	17/07/2024 26/07/2	024 12/08/2024	0.30	PASS	PASS	0.00	PASS	PASS	0.00	PASS	PASS	2.95	PASS	PASS	0.00	PASS	PASS	7.78	N/A	PASS	0	PASS	PASS	0.00	PASS	PASS	0.11	0.25
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS		1												
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS	***************************************	PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS	***************************************	PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
2024/25				PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS														
	90th percentile asses	ment	0.3			0			0			2.95			0)		0				

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 2 - Discharge point Catch Pond - 4 weekly intervals)

			Biochemic al Oxygen Demand	Faecal Coliforms	Nitrogen	Oil & Grease	Phosphor	Total Suspende d Solids	рН
Current	Min to date	0.00	0.00	80.00	4.67	0.00	0.00	7.00	7.42
Summary	Max to date	0.00	0.00	80.00	4.67	0.00	0.00	7.00	7.42
Data	Average	0.00	0.00	80.00	4.67	0.00	0.00	7.00	7.42

Licence		Date		Result							
Year	Sampled	Obtained	Published	Result	Result	Nesuit	Result	Result	Result	Nesuit	Result
2024/25	17/07/2024	26/07/2024	12/08/2024	0.00	0.00	80.00	4.67	0.00	0	7.00	7.42
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											
2024/25											

INFLOW

OUTFLOW

Condition M7.1 - Requirement to monitor volume (EPA Identification point 1 - Inlet works)

Condition M7.1 - Requirement to monitor volume (EPA Identification point 3 - Outlet

Licence
Limit
Condition

Condition

Licence

Limit
Outflow daily limit (kL)

2,160

(sect L4.1)

1 2 2 3 4 5 6 6 7 8 8 9 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31
3 4 5 6 6 7 8 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
5 6 7 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
8 9 9 10 11 11 12 13 14 15 16 17 17 18 19 20 21 22 23 24 25 26 27 28 29 30
9 10 11 12 13 14 15 16 17 18 19 20 21 22 22 23 24 25 26 27 28 29 30
10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
14 15 16 17 18 19 20 21 22 23 24 25 26 27 28
15 16 17 18 19 20 21 22 23 24 25 26 27 28 29
16 17 18 19 20 21 22 23 24 25 26 27 28 29
17 18 19 20 21 22 23 24 25 26 27 28 29
18 19 20 21 22 23 24 25 26 27 28 29
19 20 21 22 23 24 25 26 27 28 29
20 21 22 23 24 25 26 27 28 29
21 22 23 24 25 26 27 28 29
22 23 24 25 26 27 28 29
23 24 25 26 27 28 29 30
24 25 26 27 28 29 30
25 26 27 28 29 30
26 27 28 29 30
27 28 29 30
28 29 30
29 30
30
31

Maximum Average Total Minimum Maximum Average Total

July	August	September	October	November	December	January	February	March	April	May	June
932											
950											
909											
940											
938											
913											
980											
914											
1026											
929											
919											
905											
899											
909											
868											
847											
346											
858											
861											
1074											
1000											
892											
889											
864											
849											
819											
346	0	0	0	0	0	0	0	0	0	0	0
1,074	0	0	0	0	0	0	0	0	0	0	0
893	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/
23,230	0	0	0	0	0	0	0	0	0	0	0
					346						
					1,074						
					893						
					23,23)					

2023/2024 Licence Year

(sect L4.1)

				2023/2024	Licence Ye	ar				
July	August	September	October	November Decembe	January	February	March	April	May	Jun
561										
855										
587										
600										
576										
845										
909										
529										
1186										
527										
771										
455										
874										
692										
584										
767										
716										
677										
709										
1078										
750										
574										
690										
830										
502										
761										

Minimum	
Maximum	
Average	
Total	
Minimum	
Maximum	
Average	
Total	
	Maximum Average Total Minimum Maximum Average

455	0	0	0	0	0	0	0	0	0	0	0	
1,186	0	0	0	0	0	0	0	0	0	0	0	
716	#DIV/0!											
18,605	0	0	0	0	0	0	0	0	0	0	0	
					4	55						
					1,1	186						
	716											
	18,605											



Pollution monitoring data for the BRAIDWOOD sewage treatment plant in accordance with the requirements of the POELA Act 2011 and the POEO Act 1997

Site Name:	Braidwood Sewage Treatment Plant	Site Address:	26 Sandholes Road, BRAIDWOOD NSW 2622
Licencee Name	Queanbeyan-Palerang Regional Council	Address	10 Majara Street, BUNGENDORE NSW 2621
EPA Licence #	1733	Link to licence	<u>Licence</u>

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 1 - Discharge point to Flood Creek - 4 weekly intervals

	Ī		Pollutant		Ammonia		Rinchemi	cal Oxygen [lemand	Fa	ecal Colifo	rms		Nitrogen			Oil & Greas	0		pH			Phosphorus		Total	Suspended S	olids	Conductivit	Diss Al	Tot Al
		Licence Limi			mg/L		Diocriciii	mg/L	, ciniana		cfu/100m			mg/L			mg/L			nH			mg/L		1000	me/L		siemens	me/L	mg/L
		Conditions	90% limit		2			5			100			8			2		N/A				0.5			10			N/A	N/A
			100% limit		5			10			200			10			10		Between	6.5	8.5		1			15			N/A	N/A
	Compari	son Year	2020/21																											
		Current	Min to date	0.50			0.00			0.00			4.15			0.00			7.03			0.00			11.00			470	0.07	2.10
		Summary	Max to date	0.50			0.00	ï		0.00			4.15			0.00			7.03			0.00			11.00	Î		470	0.07	2.10
		Data	Average	0.50			0.00	Ĭ		0.00			4.15			0.00	ĺ		7.03	Ī		0.00	Î		11.00	Ĭ		470	0.07	2.10
nce		Date	.,			oliance			liance			pliance		Comp				oliance			pliance			pliance		Compli				4
ar	Sampled	Obtained	Published	Result	90%limit	100% limit	Result		100% limit	Result	90%limit				100% limit	Result				90%limit	100% limit	Result	90%limit	100% limit	Result	90%limit :				4—
1/25	.7/07/2024	26/07/2024	12/08/2024	0.50	PASS	PASS	0.00	PASS	PASS	0.00	PASS	PASS	4.15	PASS	PASS	0.00	PASS	PASS	7.03	N/A	PASS	0	PASS	PASS	11.00	WARNING	PASS	470	0.07	2.10
1/25 1/25					PASS PASS	PASS PASS		PASS	PASS		PASS	PASS		PASS PASS	PASS		PASS	PASS		N/A N/A	FAIL FAIL		PASS PASS	PASS PASS		PASS PASS	PASS			4
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS	-	N/A	FAIL		PASS	PASS		PASS	PASS			1
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS	-	N/A	FAIL		PASS	PASS		PASS	PASS			_
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS	***************************************	N/A	FAIL		PASS	PASS	***************************************	PASS	PASS			1
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS	***************************************	N/A	FAIL		PASS	PASS		PASS	PASS			-
1/25					PASS	PASS		PASS	PASS	***************************************	PASS	PASS		PASS	PASS		PASS	PASS	***************************************	N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS	******************	PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			
1/25					PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A	FAIL		PASS	PASS		PASS	PASS			4

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 3 - Downstream at Boppings Crossing - Special intervals

	ı	Current	Min to date	Ammonia 0.00	Biochemical Oxygen Demand 0.00	Faecal Coliforms 40.00	Nitrogen	Oil & Grease	Phosphor us 0.00	Total Suspende d Solids 3.00	pH 7.94	Conductiv ity 336	Diss Al	Tot Al
		Summary	Max to date	0.00	0.00	40.00	1.64	0.00	0.00	3.00	7.94	336	0.06	0.11
		Data	Average	0.00	0.00	40.00	1.64	0.00	0.00	3.00	7.94	336	0.06	0.11
Licence		Date		Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result
Year	Sampled	Obtained	Published	Result	Result	Result	Result	Nesuit	Result	Nesuit	Result	Nesuit	Result	Result
2024/25	17/07/2024	26/07/2024	12/08/2024	0.00	0.00	40.00	1.64	0.00	0.00	3.00	7.94	336.00	0.06	0.11
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														
2024/25														

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 4 - Upstream at Archer Bridge - Special intervals

rd	Date Obtained	Published	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result
	Data	Average	0.00	0.00	180.00	2.11	0.00	0.00	4.00	7.97	309	0.04	0.12
	Summary	Max to date	0.00	0.00	180.00	2.11	0.00	0.00	4.00	7.97	309	0.04	0.12
	Current	Min to date	0.00	0.00	180.00	2.11	0.00	0.00	4.00	7.97	309	0.04	0.12
			Ammonia	Demand	Coliforms	Nitrogen	Grease	us	d Solids	pH	ity)	m (total)
				Oxygen	Faecal		Oil &	Phosphor	Suspende		Conductiv	(dissolved	Aluminiu
				Biochemical					Total			m	
												Aluminiu	

2024/25	26/07/2024	0.00	0.00	180.00	2.11	0.00	0	4.00	7.97	309.00	0.04	0.12
2024/25												
2024/25												
2024/25												
2024/25												
2024/25												
2024/25												
2024/25 2024/25												
2024/25												
2024/25								***************************************				***************************************
2024/25						*****************						************
2024/25												
2024/25			***************************************			****************				***************************************		************

OUTFLOW

Condition M7.1 - Requirement to monitor volume (EPA Identification point 1 - Outlet works)




July	August	September	October	November	December	January	February	March	April	May	June
293											
293 261											
261											
296											
283											
297											
282											
285											
327											
300											
277											
283											
285											
267											
265											
270											
278											
266											
260											
260	0	0	0	0	0	0	0	0	0	0	0
327	0	0	0	0	0	0	0	0	0	0	0
283	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!
5,372	0	0	0	0	0	0	0	0	0	0	0
.,.					260			-			
					327						

INFLOW

Condition M7.1 - Requirement to monitor volume (EPA Identification point 2 - Inlet Works



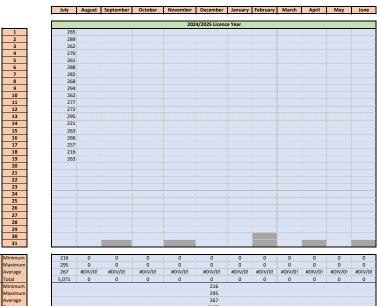

	Minimum
Monthly	Maximum
iviolitiliy	Average
	Total
	Minimum
YTD	Maximum
TID	Average
	Total



Pollution monitoring data for the CAPTAINS FLAT sewage treatment plant in accordance with the requirements of the POELA Act 2011 and the POEO Act 1997

Vear 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25 2024/25

Site Name:	Captains Flat Sewage Treatment Plant	Site Address:	1 Miners Road CAPTAINS FLAT NSW 2623
Licencee Name	Queanbeyan-Palerang Regional Council	Address	10 Majara Street, BUNGENDORE NSW 2621
EPA Licence #	1929	Link to licence	<u>Licence</u>

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 1 - Effluent Distribution Pit - 4 weekly intervals)

		Pollutant		Ammonia		Biochen	nical Oxygen D	emand	F	aecal Coliforms			Nitrogen			Oil & Grease			pH			Phosphorus		Total S	uspended So	lids	Diss Al	Tot
	Licence Limit			mg/L			mg/L			cfu/100mL			mg/L			mg/L			pН			mg/L			mg/L		mg/L	mg
	Conditions (sec	+ 90% limit		2			10			100			8			2		N/A				0.5			10		N/A	N/
	L3.4)	100% limit		5			20			200			10			10		Between	6.5	8.5		1			15		N/A	N
	Comparison Ye	ar 2020/21																										
	Current	Min to date	0.20			0.00			2.00			3.73			0.00			7.27			0.12			8.00			0.06	0.
		Max to date	0.20			0.00			2.00		ì	3.73			0.00			7.27			0.12			8.00			0.06	0
	Summary Data	Average	0.20			0.00			2.00		î	3.73			0.00			7.27			0.12			8.00			0.06	0
	Date	,		Compl			Comp	liance		Complia	nce		Comp	iance		Compl				liance			pliance		Comp			
mple		Published	Result	90%limit	100% limit	Result	90%limit	100% limit	Result	90%limit 10	10% limit		90%limit	100% limit	Result	90%limit	100% limit	Result		100% limit	Result	90%limit	100% limit	Result		100% limit		
7/20	024 26/07/2024	12/08/2024	0.20	PASS	PASS	0.00	PASS	PASS	2.00		PASS	3.73	PASS	PASS	0.00	PASS	PASS	7.27	N/A	PASS	0.12	PASS	PASS	8.00	PASS	PASS	0.06	0.
				PASS	PASS		PASS	PASS			PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
				PASS	PASS		PASS	PASS			PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
				PASS	PASS		PASS	PASS			PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
				PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
				PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
								PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
				PASS	PASS		PASS	PASS																				
				PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS	PASS		
					PASS PASS PASS					PASS			PASS PASS	PASS PASS		PASS PASS	PASS PASS		N/A N/A			PASS PASS	PASS PASS					
				PASS	PASS PASS PASS		PASS	PASS		PASS PASS	PASS														PASS	PASS		
				PASS PASS	PASS PASS PASS		PASS PASS	PASS PASS		PASS PASS PASS	PASS PASS		PASS	PASS		PASS	PASS		N/A			PASS	PASS		PASS PASS	PASS PASS		

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 2 - Upstream at Rear of Number 2 Foxlow Street)

Oxygen Faecal Phosphor Suspende Coliforms Nitrogen Oil & Grease us d Solids pH Diss Al	
Ammonia Demand Coliforms Nitrogen Oil & Greace us d Solids pH Diss Al	
Authorita Schildren State Control of Control	Tot Al
Current Min to date 0.00 0.00 0.00 0.29 0.00 0.00 6.00 7.29 0.2	0.37
Max to date 0.00 0.00 0.00 0.29 0.00 0.00 6.00 7.29 0.2	0.37
Summary Data Average 0.00 0.00 0.00 0.29 0.00 0.00 6.00 7.29 0.20	0.37

Licence		Date		Result									
Year	Sampled	Obtained	Published	Result									
2024/25	17/07/2024	26/07/2024	12/08/2024	0.00	0.00	0.00	0.29	0.00	0.00	6.00	7.29	0.20	0.37
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													
2024/25													

Condition M2 - Requirement to monitor concentration of pollutants discharged (EPA Identification point 3 - Downstream at Molonglo River Bridge MR270)

				Biochemical					Total			
				Oxygen	Faecal			Phosphor	Suspende			
			Ammonia	Demand	Coliforms	Nitrogen	Oil & Grease	us	d Solids	pH	Diss Al	Tot Al
Г	Current	Min to date	0.00	0.00	0.00	0.25	0.00	0.00	8.00	6.89	0.13	0.48
ı		Max to date	0.00	0.00	0.00	0.25	0.00	0.00	8.00	6.89	0.13	0.48
	Summary Data	Average	0.00	0.00	0.00	0.25	0.00	0.00	8.00	6.89	0.13	0.48

Date			Danula	Daniela	Danula	Danula	DI4	Danula	Danish	Danish	Danish	Daniela
Sampled	Obtained	Published	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result
17/07/2024	26/07/2024	12/08/2024	0.00	0.00	0.00	0.25	0.00	0.00	8.00	6.89	0.13	0.48
	Sampled 17/07/2024	Sampled Obtained 17/07/2024 26/07/2024	Sampled Obtained Published 17/07/2024 26/07/2024 12/08/2024	Sampled Obtained Published Result 17/07/2024 26/07/2024 12/08/2024 0.00	Sampled Obtained Published Result Result 17/07/2024 26/07/2024 12/08/2024 0.00 0.00	Sampled Obtained Published Result Result Result 17/07/2024 26/07/2024 12/08/2024 0.00 0.00 0.00	Sampled Obtained Published Result Result Result Result Result 17/07/2024 26/07/2024 12/08/2024 0.00 0.00 0.00 0.00 0.25	Sampled Obtained Published Result Result Result Result Result Result Result 17/07/2024 26/07/2024 12/08/2024 0.00 0.00 0.00 0.00 0.25 0.00	Sampled Obtained Published Result R	Sampled Obtained Published Result R	Sampled Obtained Published Result R	Sampled Obtained Published Result R

2024/25							
2024/25							
2024/25							
2024/25							
2024/25							
2024/25							

OUTFLOW


Condition M7.1 - Requirement to monitor volume (EPA Identification point 1 - Outlet works)



verage

aximum

YTD

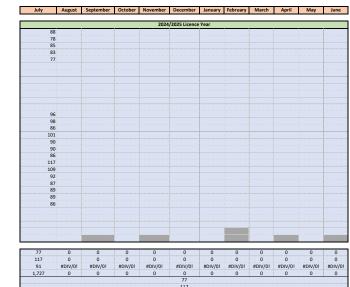

INFLOW

Condition M7.1 - Requirement to monitor volume (EPA Identification point 4 - Inlet Works)

Licence Limit Outflow daily limit (kL) 324 (sect 13.1)

